REVISIONS			
REV	DESCRIPTION	DATE/BY	APPROVED

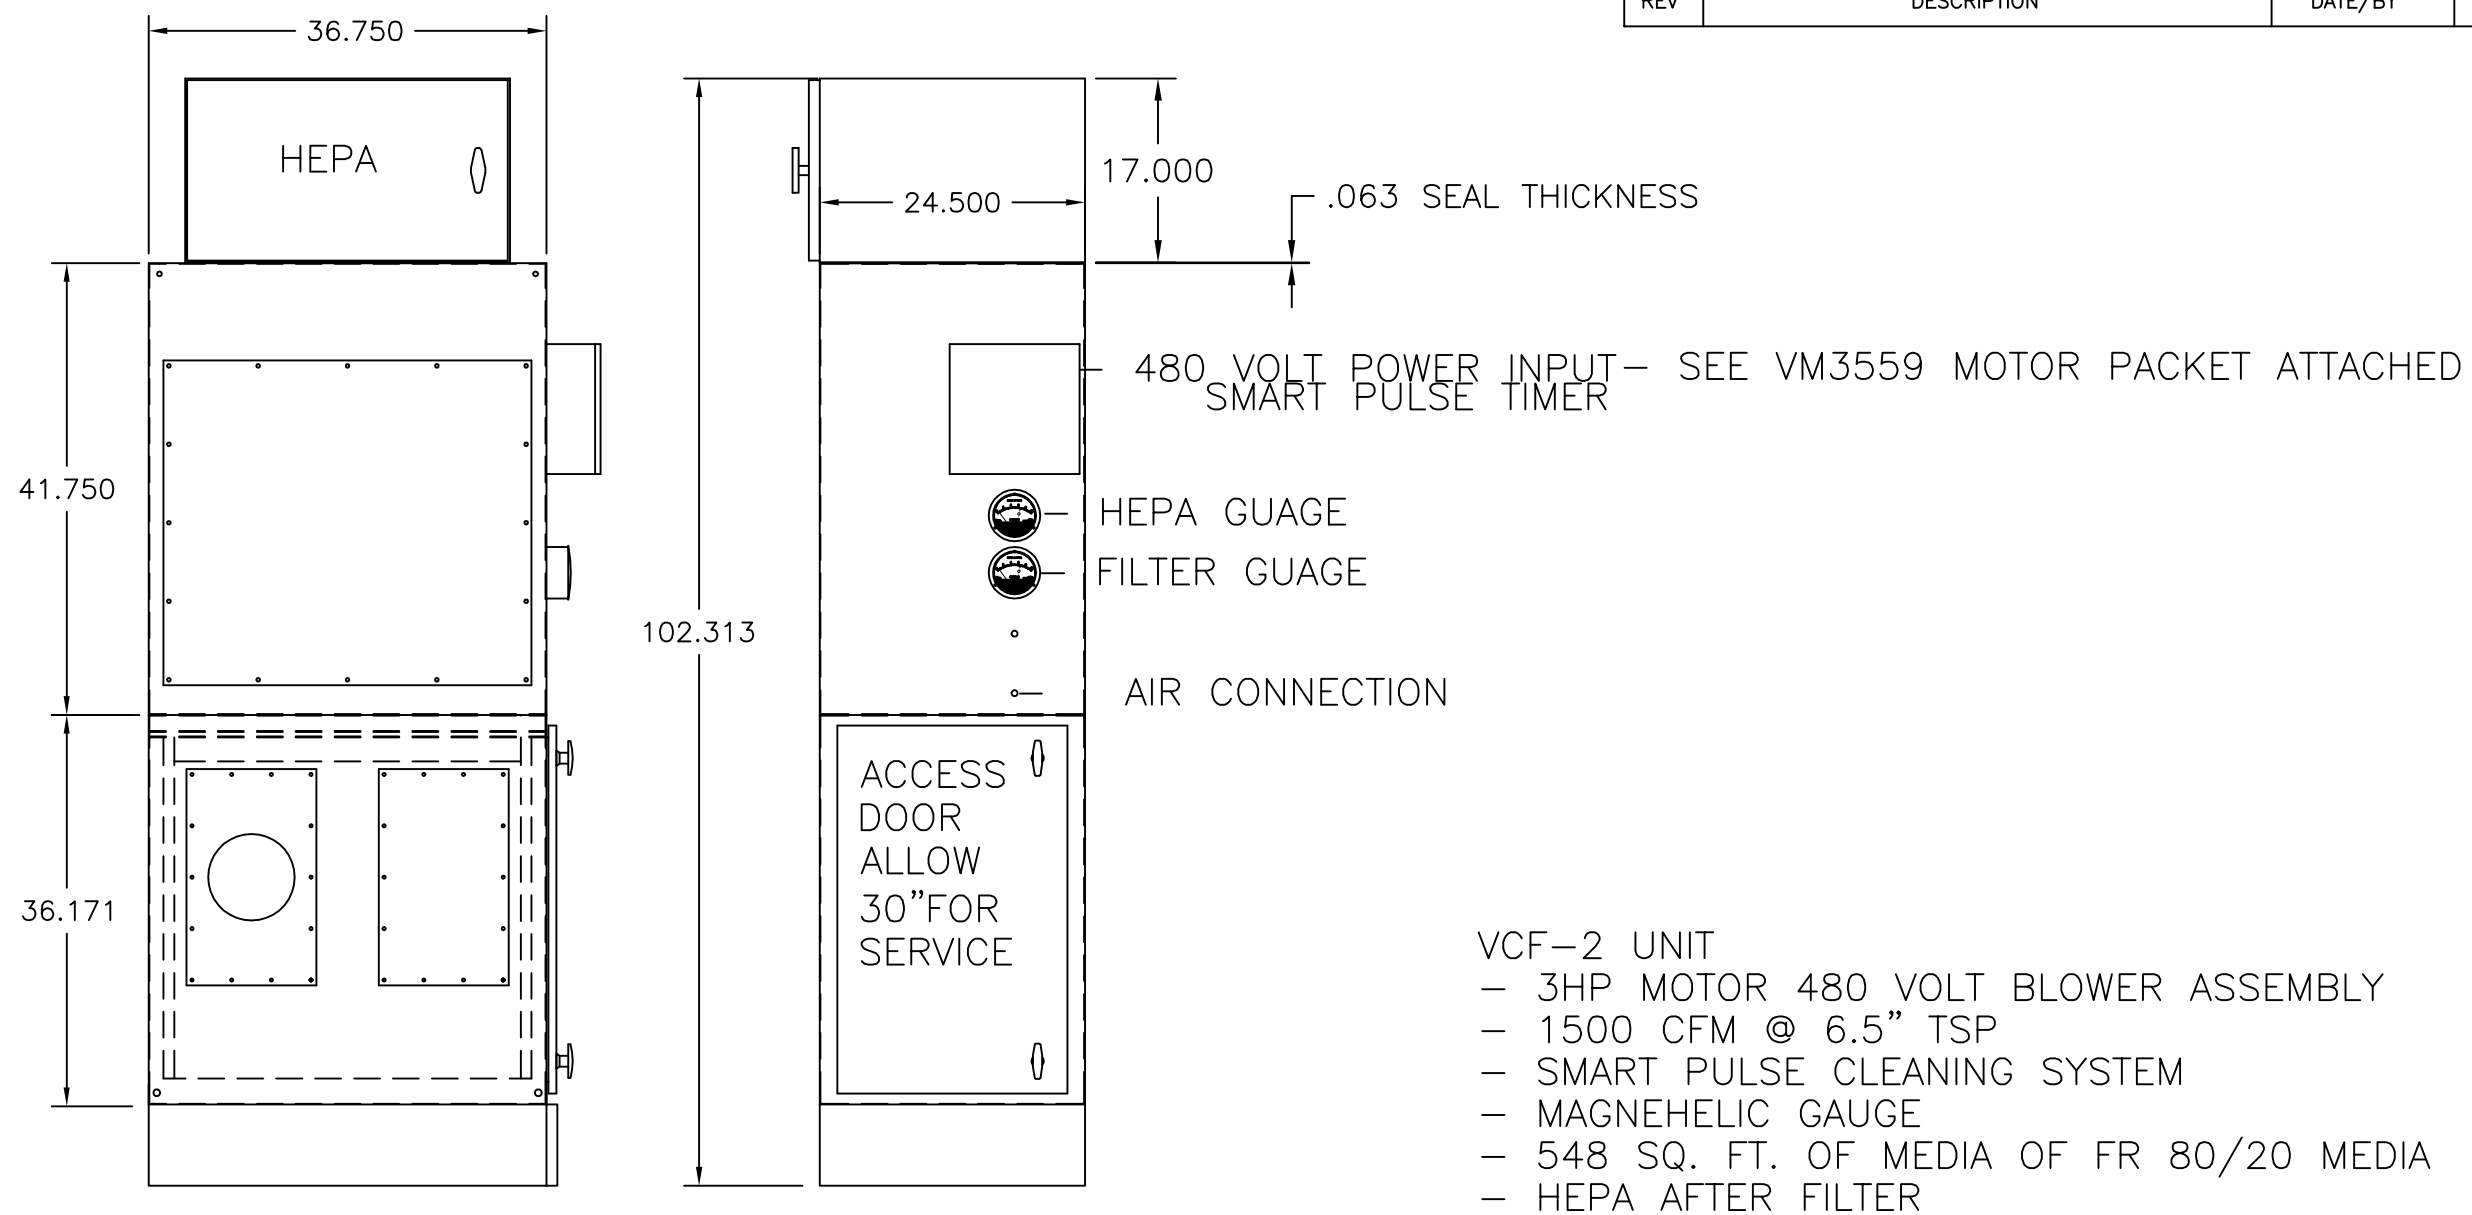

VCF–2 UNIT
– 3HP MOTOR 480 VOLT BLOWER ASSEMBLY
– 1500 CFM @ 6.5" TSP
– SMART PULSE CLEANING SYSTEM
– MAGNEHELIC GAUGE
– 548 SQ. FT. OF MEDIA OF FR 80/20 MEDIA
– HEPA AFTER FILTER
– DUST DRAWER
–
–
–

AER Control Systems
416 S. CHERRY STREET
P.O. BOX 1468
WALLINGFORD, CT. 06492
1.888.265.2372

TITLE: VCF–2 WITH HEPA,
~

DWG. NO.: 4/1/2024
REVISION: ~
SCALE: ~
SHEET: 1 of 1

MATERIAL:
REFERENCE:
WEIGHT:

DWN.: J.DIXON
DATE: 4/1/2024
CHK.:
DATE:
APVD:
DATE:

DO NOT SCALE
TOLERANCES UNLESS OTHERWISE SPECIFIED 2 PL= 3 PL= ANGLES=
THIRD ANGLE PROJECTION
ALL DIMENSIONS ARE OUTSIDE U.O.S.
DWG. SIZE B

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF AER CONTROL SYSTEMS. ALL RIGHTS TO MANUFACTURE, COPY, OR REPRODUCE THIS DRAWING OR ITS CONTENTS ARE RESERVED BY AER CONTROL SYSTEMS, INC.

~